


COPYRIGHT © 2016 SOUTHGATE WATER & SANITATION DISTRICTS

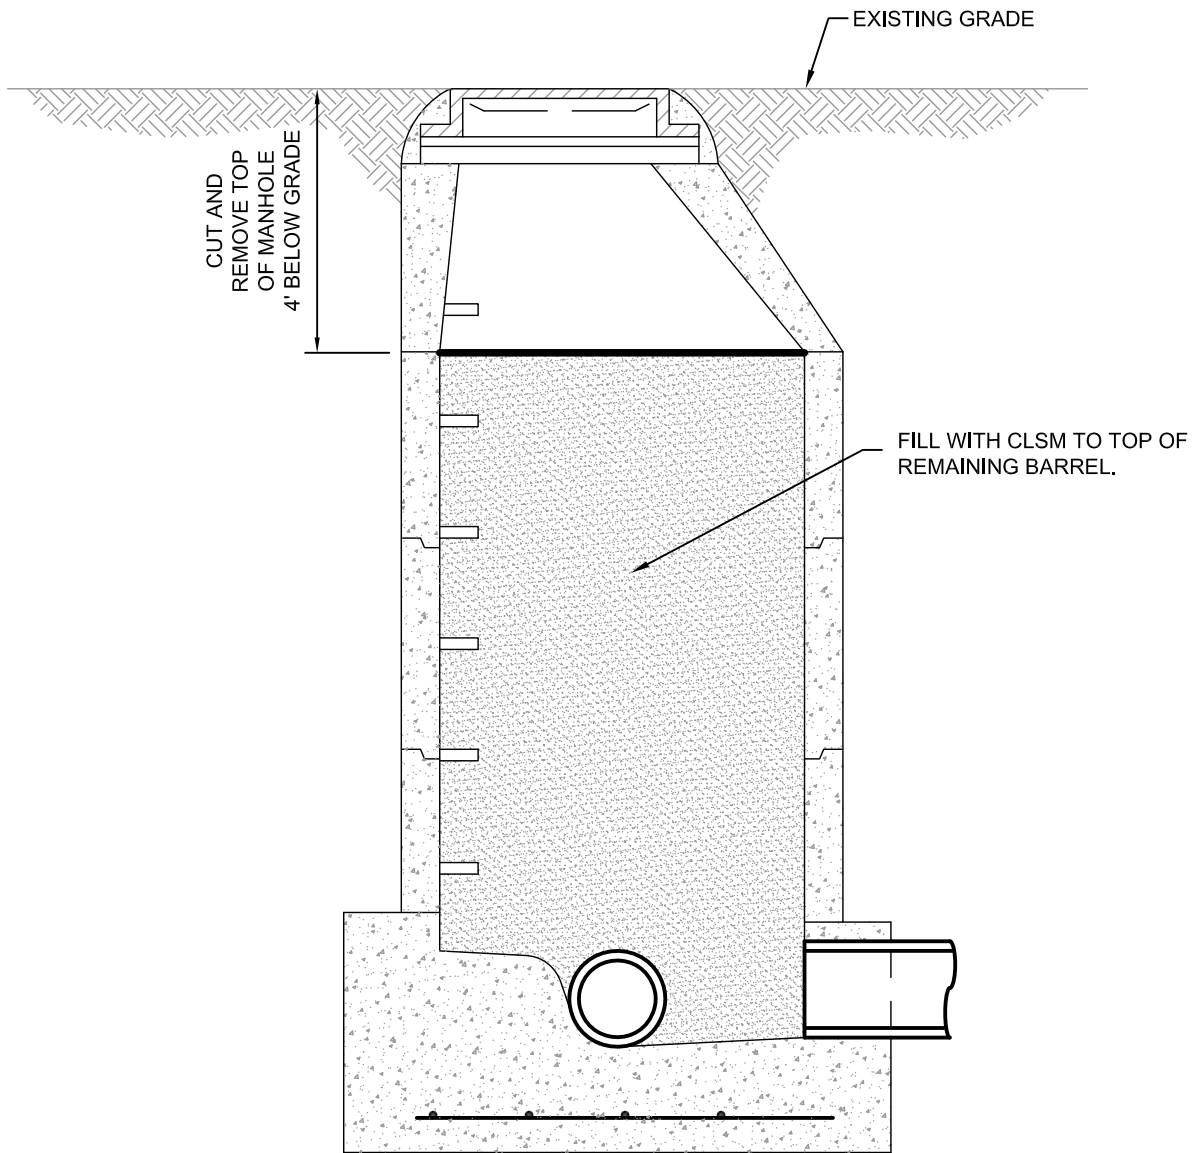

PROFILE VIEW

NOTES:

1. CUT EXISTING SANITARY MANHOLE TO FOUR (4) FEET BELOW GRADE.
2. PLUG INVERTS IN MANHOLE.
3. FILL STRUCTURE WITH CONTROLLED LOW STRENGTH MATERIAL (CLSM) HAVING LONG-TERM COMPRESSIVE STRENGTH BETWEEN 50-200PSI.
4. BACKFILL AND RESTORE AREA.

REVISED		 <p>Southgate WATER & SANITATION DISTRICTS</p>	SCALE
BY	DATE		NOT TO SCALE
		<p>SANITARY SEWER MANHOLE ABANDONMENT</p>	ISSUE DATE
			FEBRUARY 2016
			SHEET 1 OF 1 DRAWING NO. SS-25