


COPYRIGHT © 2016 SOUTHGATE WATER & SANITATION DISTRICTS

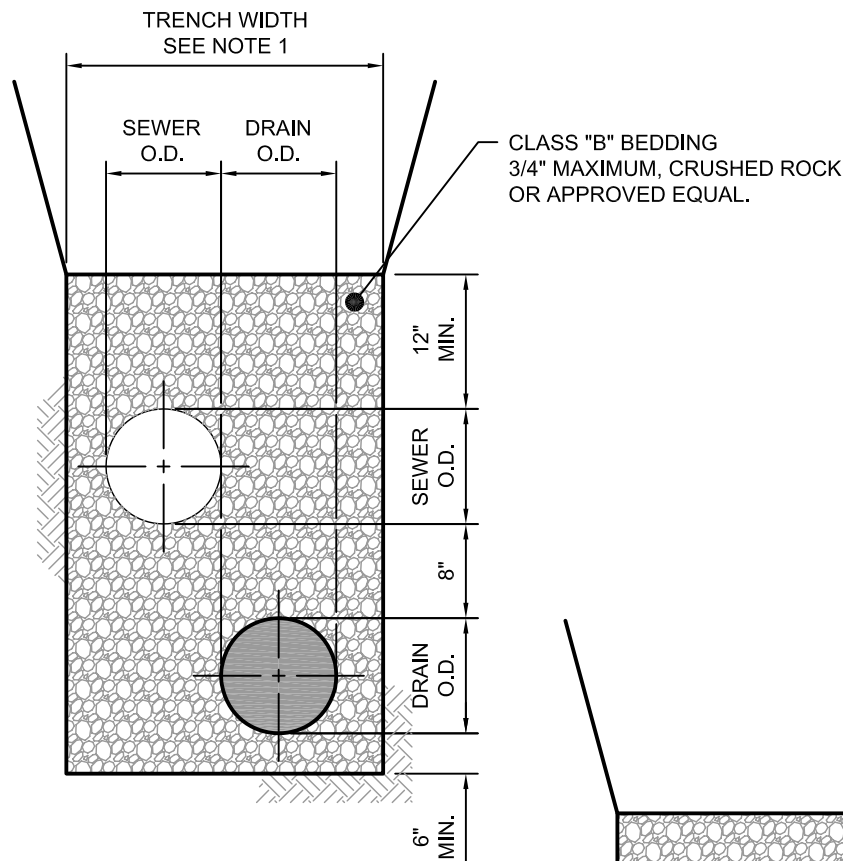


**TYPICAL MAIN LINE TRENCH  
W/ CLOSED PIPE UNDERDRAIN**

**NOTE:**  
TO BE USED IN CONJUNCTION WITH  
STANDARD BEDDING DETAIL FOR TRENCH,  
BEDDING AND COMPACTION REQUIREMENTS.

SINGLE LAYER 8 MIL.  
POLYETHYLENE PLASTIC

ALTERNATE LOCATION  
OF POLYETHYLENE PLASTIC

**ALTERNATIVE MAIN LINE TRENCH WITH  
CLOSED OR OPEN PIPE UNDERDRAIN**

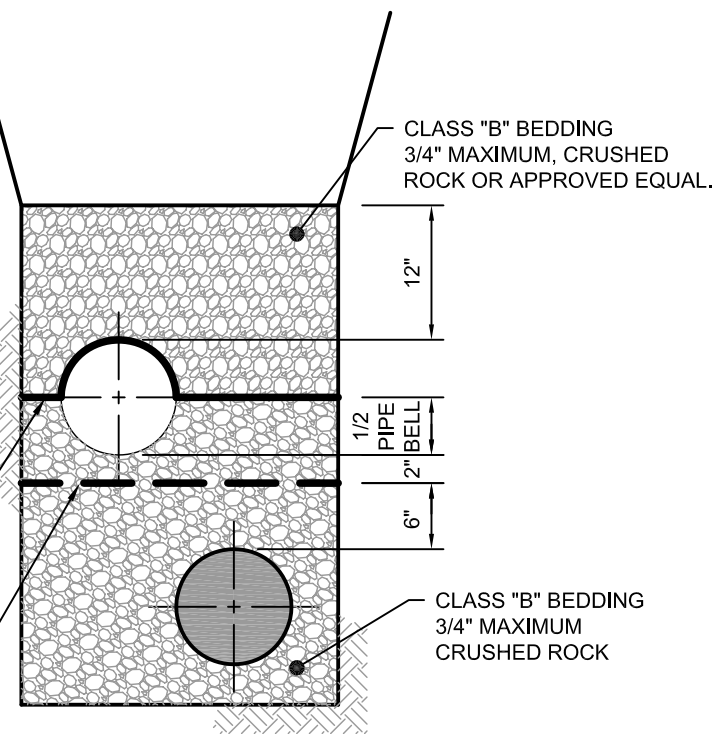

**NOTE:**  
TO BE USED IN CONJUNCTION WITH  
STANDARD BEDDING DETAIL FOR TRENCH,  
BEDDING AND COMPACTION REQUIREMENTS.

<b>REVISED</b>		 <b>Southgate</b> WATER & SANITATION DISTRICTS	SCALE
BY	DATE		NOT TO SCALE
			ISSUE DATE
			FEBRUARY 2016
			SHEET
			DRAWING NO.
			<b>1 OF 1</b>
			<b>SS-29</b>
<b>SANITARY SEWER TRENCH WITH PRIVATELY OWNED UNDERDRAIN</b>			